

PHOENIX[®] Sanitizer Heat Transfer

Advanced Heating and Hot Water Systems



Certifications and Ratings:

The heaters are UL/ULC listed and meet or exceed thermal efficiency and standby loss requirements of current ASHRAE standards. All water heaters are supplied with AGA/ASME rated temperature and pressure relief valve. The control panel is an integrated solid state temperature and ignition control device with integral diagnostics, LED fault display capability and a digital display of temperature settings. Meets all safety and construction requirements of ANSI Z21.10.3

CERTIFIED FOR A 150 PSI MAXIMUM WORKING PRESSURE.


Sealed-Combustion Gas-Fired Mod/Con Booster Heaters

130,000 BTU/Hr. thru 199,000 BTU/Hr.


Phoenix Gas-Fired Mod/Con Booster Heaters are specifically designed to provide customers with maximum savings on operation, space and installation. Designed with the most advanced technology available, these products optimize efficiency and operating reliability.

Construction Features:

- 316L stainless steel tank construction (requires no anode rods).
- Load-Matching Modulating Burner
- No chimney required; direct vent using plastic pipe.
- Thermal efficiency of up to 96% dramatically reduces operating costs
- 85 equivalent feet of vent length.
- Low NO_x emissions. Meets SCAQMD Rule 1146.2
- High impact plastic jacket eliminates dents.
- 2" of non-CFC polyurethane foam insulation.
- Less than 1/2 degree per hour heat loss (R17).
- Corrosion-resistant, high efficiency 90/10 cupronickel heat exchanger.
- Self-diagnostic electronic control with digital readout for water temperature, set point and differential.
- Removable front cover allows easy access to burner assembly (24" service clearance recommended).
- Temperature range from 70° to 184°
- Zero clearance to all combustible surfaces.
- Factory installed AGA/ASME rated T&P relief valve.

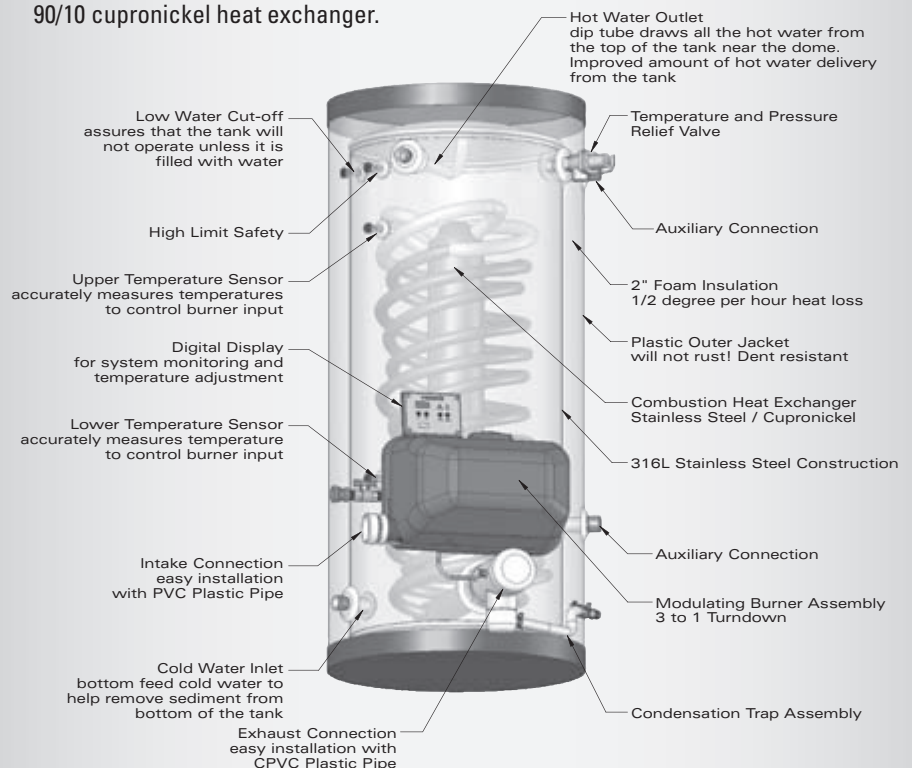

PHOENIX® Sanitizer Dimensional Information

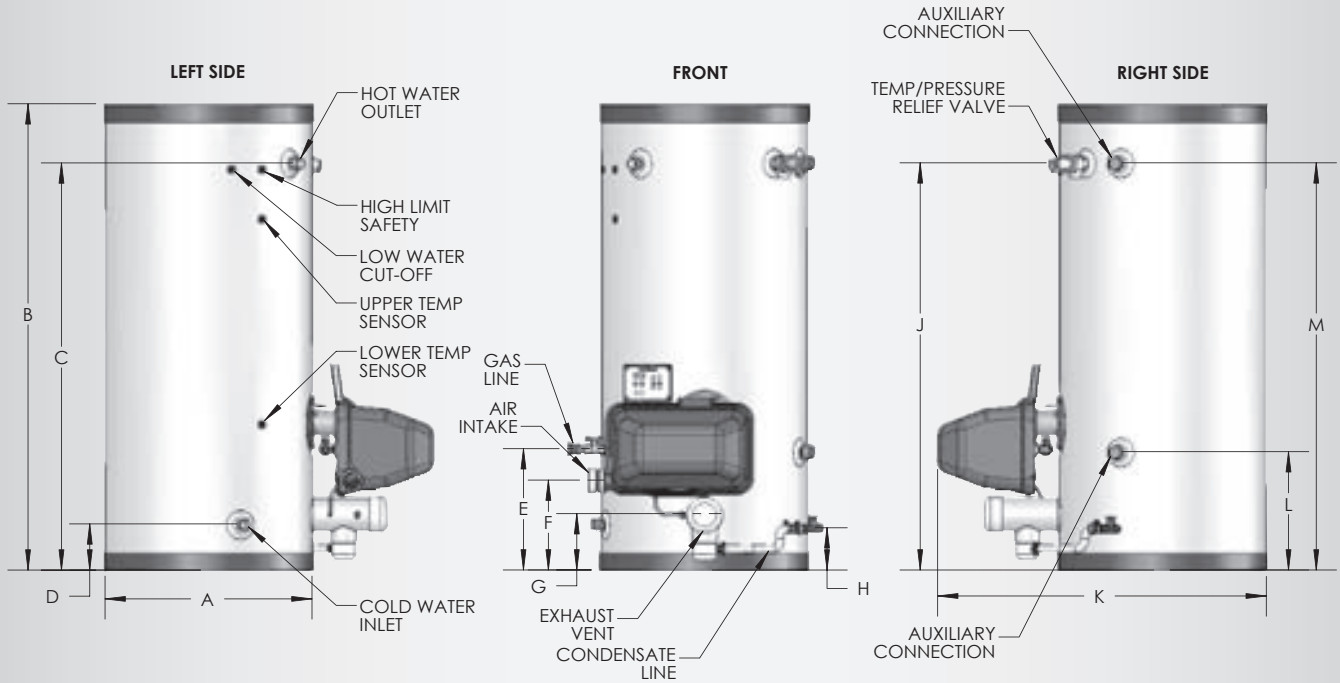

PHOENIX WATER HEATER DIMENSIONS

MODEL #	GALLONS	A	B	C	D	E	F	G	H	J	K	L	M
PH-55 SA	55	23"	52"	45"	5"	13-1/4"	9-3/4"	6"	3-7/8"	44-3/4"	36"	13"	45"


ALL DIMENSIONS ARE APPROXIMATE

PHOENIX WATER HEATER SPECIFICATIONS


MODEL #	GALLONS	BTU's	AIR INTAKE/ EXHAUST VENT SIZE	WATER INLET/ OUTLET SIZE	AUXILIARY CONN.	GAS LINE CONN.	SYSTEM RELIEF PIPE SIZE	SHIPPING WEIGHT
PH-55 SA	55	130,000	2"	1" NPT	1"	3/4"	3/4"	175 LBS.
		199,000	3"					

PHOENIX® Sanitizer Venting Options


SIDEWALL VENTING WITH TEE (INTAKE) AND COUPLING (EXHAUST)

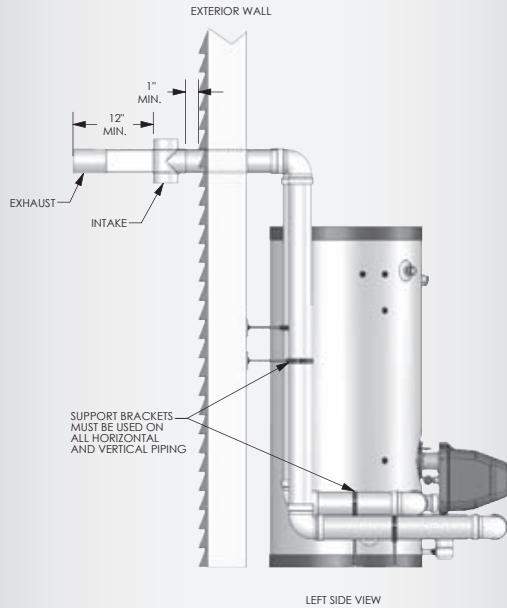

SIDEWALL VENTING WITH CONCENTRIC VENT KIT

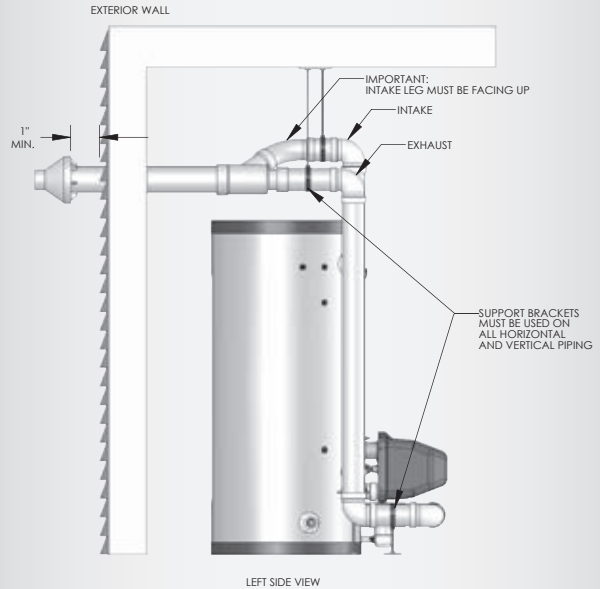

PHOENIX SANITIZER BOOSTER INSTALLATION P/N PH130-55SA / PH199-55SA

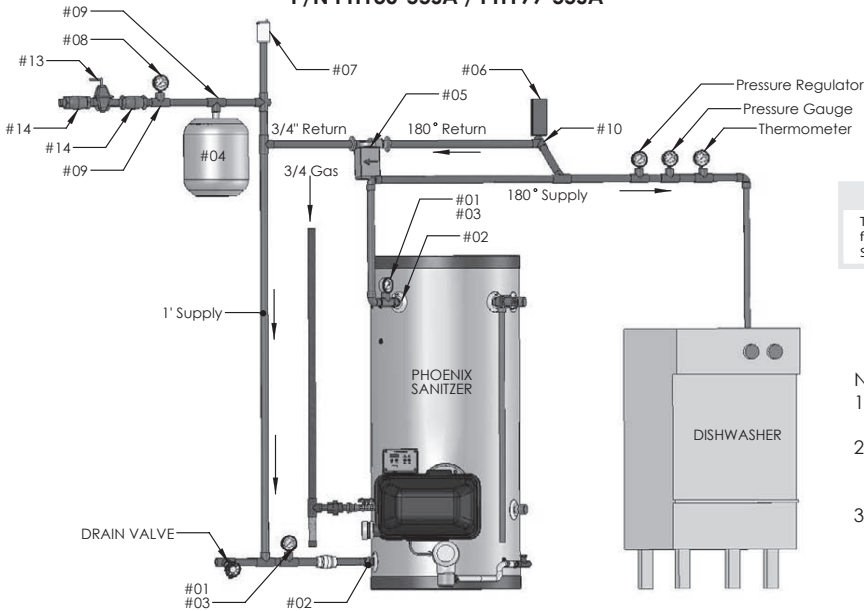

NOTICE

The standard Phoenix Water Heater does not meet the required temperature settings for sanitizer booster applications. The maximum temperature setting for the Phoenix Sanitizer Booster is 184°.

NOTES:

1. Minimum pipe size should match connection size on Phoenix. If you require greater flow, upsize the pipe accordingly.
2. A Thermal Expansion tank suitable for potable water must be sized and installed within this piping system between the backflow preventer and the cold water inlet of the Phoenix.
3. Gas line must be rated to the maximum input capacity of the unit. Unit must have 10 feet of pipe after gas regulator.

WARNING; INCOMING SUPPLY MUST BE NO FURTHER THAN 5' FROM THE SANITIZER

VERY IMPORTANT: INSULATE ALL PIPES ON RECIRCULATION LINE TO AND FROM SANITIZER

THE ITEMS LISTED BELOW ARE THE ITEMS AND PART NUMBERS IN THE VSBK-1200 SANITIZER BOOSTER KIT.

ITEM	PART	DESCRIPTION	PART NUMBER	ITEM	PART	DESCRIPTION	PART NUMBER
#01	NIBCO TEE	1"X1"X 1/2"	7000-708	#08	PRESSURE GAUGE		7000-716
#02	FEMALE ADAPTER	1"	7000-709	#09	NIBCO TEE	1" X 1" X 3/4" 712R	7000-728
#03	DIAL THERMOMETER		7000-710	#10	NIBCO TEE	1" X 1/2" X 1" COPPER	7000-739
#04	EXPANSION TANK 4.5 GAL		7000-711	#11	NIBCO TEE	1" X 1/2" X 1" R	7000-730
#05	GRUNDFOS 3 SPEED PUMP	W/ CHECK VALVE	7000-712	#12	REDUCING COUPLING		7000-732
#06	NIBCO TEE	1/2" X 1/2" FITTING AIR CHAMBER	7000-737	#13	PRESSURE REDUCING VALVE		7000-733
#07	VACUUM RELIEF VALVE		7000-714	#14	NIBCO MALE ADAPTERS		7000-736

NOTE: In Massachusetts you must install a vacuum relief valve per 248 CMR.

LP-179-SA
10/6/09

PHOENIX[®] Sanitizer

PHOENIX[®] Sanitizer Recovery Capacities

Model	Input Modulation	40° rise	50° rise	60° rise	70° rise	80° rise	90° rise	100° rise	110° rise	120° rise	Gallon Capacity	First Hr Rating	Thermal Efficiency
PH199-55 SA	66,000–199,000	573	458	382	327	286	254	229	208	191	55	295 Gallons	95%
PH130-55 SA	44,000–130,000	370	296	247	211	185	164	148	134	123	55	205 Gallons	93.7%

Recovery ratings are based on thermal efficiencies per ANSI Z21.10.3-1998

PHOENIX[®] Specification

The Phoenix Sanitizer Booster Heater shall be manufactured by Heat Transfer Products, Inc. with identification of model number PH_____. The water heater shall be a sealed combustion system, taking only outside air for combustion and exhausting the flue gas with PVC Schedule 40 or 80 PVC, or CPVC solid core pipe. The heater as well as all related intake air and exhaust intake air and exhaust gas piping shall be approved for zero clearance to any combustible surface. The units total combined equivalent venting length, including fitting allowances for both the intake air and exhaust gas shall not exceed 85' (in the units native size as manufactured and stated on the unit model product data sheet) in 2", or 3" pipe or 125' for the next size up of 3" or 4" from the heaters location.

The heaters tank shall be constructed of 316L stainless steel. The primary condensing heat exchanger shall be constructed of 90/10 cupronickel. The secondary heat exchanger shall be constructed of 800H stainless steel and 90/10 cupronickel. The tank insulation shall be water blown foam 2" thick in the side wall with a rating of R14.2 and 3" thick in the top with a rating of R21.3. Insulation shall be enclosed in a plastic jacket on the sides as well as the top and bottom. All components shall be located on the front of the heater for easy access and serviceability. All related hardware shall be constructed of stainless

steel studs with brass nuts for serviceability. All water connection nipples shall be constructed of stainless steel and be attached to the side of the tank. The top and bottom of the tank shall be smooth with no pipe tappings on the top or legs on the bottom.

The heaters shall be UL/ULC listed and will exceed the minimum efficiency requirements of ASHRAE 90.1b. All heaters shall be approved in accordance with ANSI Z 21.10.3. All heaters will be supplied with a factory installed ASME rated temperature and pressure relief valve. All heaters shall be supplied with a factory installed low water cutoff, and upper hot water sensor, and lower cold water sensor. All heaters shall be furnished with a factory installed condensate trap assembly ready for easy connection to a field supplied condensate drain.

The heater shall have an integrated digital controller device with integral diagnostics, LED fault and temperature settings for establishing set point, temperature differential. Ignition shall be with direct spark with ignition taking place at a pre-set ignition speed for the burner blower. The control shall utilize an algorithm to fully adjust the burner modulating firing rate while maintaining the desired temperature. The pre-mix stainless steel burner uses a 120 volt motor with pulse wave modulation control to change the fan speed, thus the combustion

air volume of fuel and air through the burner to establish an infinite BTU input range equal to the water heating set point requirement. The digital LED control display shall provide means, via push buttons, for adjustments of operating temperatures, differential adjustment, ECO reset, service mode, and real time status mode. In addition there shall be provided a computer connection via laptop computer for perpetual history including all fault codes, and hours of operation above 50% of input, below 50% of input as well as real time status reporting of all operations. The burner assembly shall be mounted so as to be easily removed as an integral unit for easy serviceability.

The heater shall be in compliance with the NOx Emissions limit as set forth in SCAQMD Rule 1146.2 .

The heater shall be factory assembled; test fired for correct BTU input and adjusted for proper combustion parameters. Complete operating and installation instructions shall be furnished with every heater as packaged by the manufacturer with the heater for shipping.

Heat Transfer
Advanced Heating and
Hot Water Systems